
Soil Non-Time Critical Removal Action (2020-2024)



PG&E Topock Compressor Station, Needles, California November 2022

2023								2024					
Q2	Q3			Q4			Q1			Q2			
MJ	J	A	S	0	N	D	J	F	М	A	М	J	
						* * * *							
						- - - - -							
						8 8 8 8 8 8 8							
						8 8 8 8 8 8							
						5 5 5 6 8 8							
						5 5 6 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8							
						5 5 5 6 7 7							
						5 5 6 7 7							
						5 5 5 7 7							
						2 2 2 2 2 2 2 2 2							
						2 2 2 2 2 2							
RTCs)													
						- - - - -							
						8 8 8 8 8 8 8 8							
						* * * *							
	luonale		4 \\/			5 5 5 6 7 7							
PG&E	Imple	men		k Pla	n								
				_	• • •								
			Tribe										
			Stak						nt				
							ment						
			DO	Rev	iew/C	omm	ent						
d Comm	ents	Table				8 8 8 8 8 8 8 8 8 8 8 8 8 8 8							
ents/Ser	nd RT	C Tal	ole 🗖										
ew RTCs	/Com	nmen	t Res	olutio	on 🗖								
isk Asse	essme	ent A	dden	dum l	Repo	rt 🗖							
	D	TSC F	Review	w/Ac	cept l	Repo	rt 🔲						
	1		Revie										
		г	DOI R	eview	v/Acc	ent R	enor						
		L				sprin	5401						

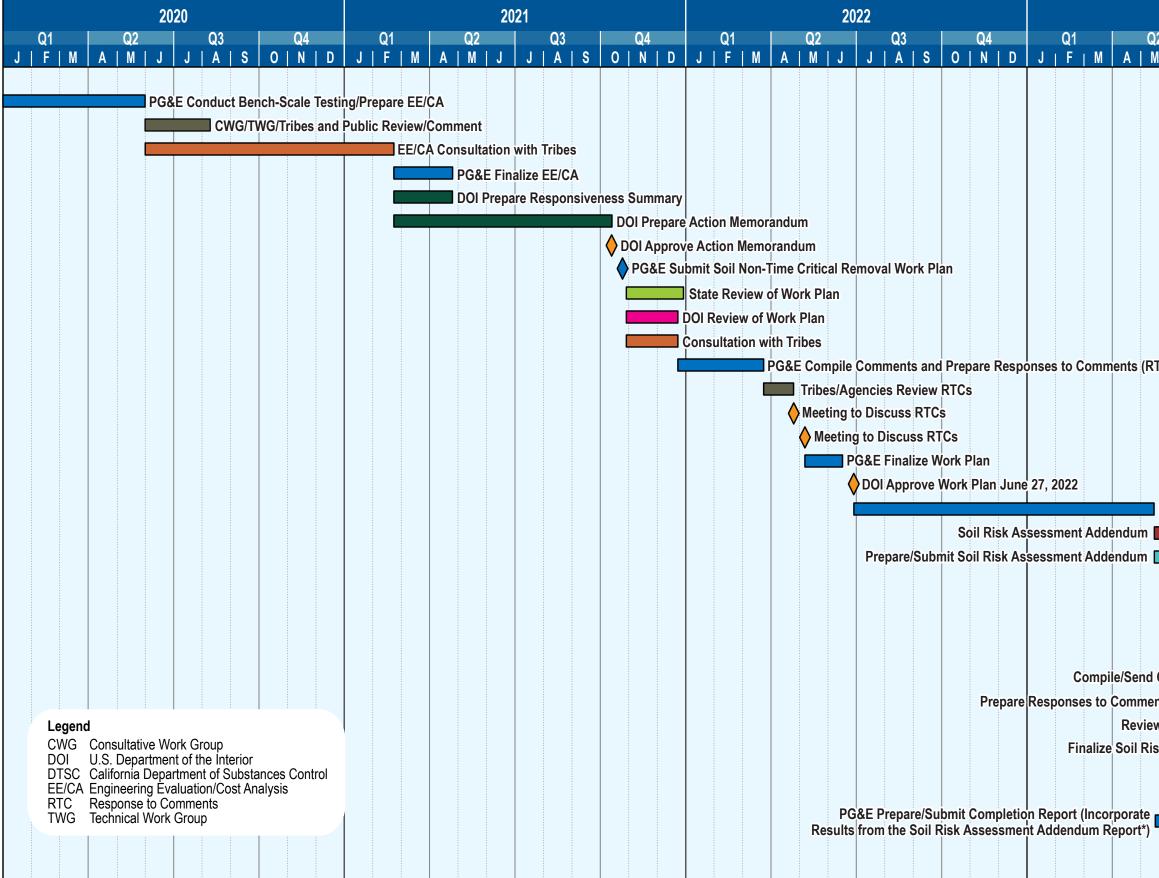